
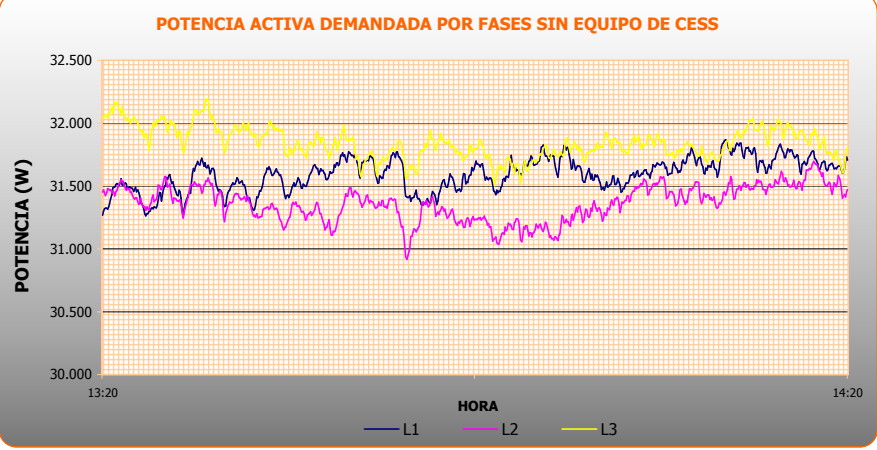


# CESS CÁMARA FRIGORÍFICA

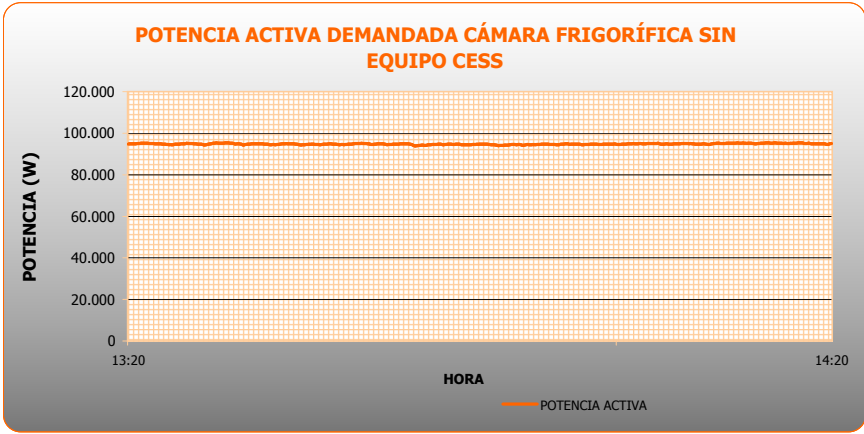

SIN EQUIPO	L1	L2	L3
MÁXIMO (W)	31.869,6	31.695,7	32.194,3
MÍNIMO (W)	31.258,7	30.917,6	31.503,2
PROMEDIO (W)	31.593,7	31.360,7	31.842,8
horas	8.760,0	8.760,0	8.760,0
consumo por fase (kWh)	276.760,8	274.719,7	278.942,9
consumo anual estimado (kWh)	830.423,5		
PF	0,860	0,870	0,890

## CONCLUSIONES COMPARATIVA CÁMARA FRIGORÍFICA CESS CASUR

	L1	L2	L3	medio
variación del maximo de potencia	15,2%	14,9%	15,8%	15,3%
variación del promedio de potencia	18,5%	16,6%	17,0%	17,4%
variación consumo anual	17,4%			
variación PF	1,2%	3,4%	0,0%	1,5%

CESS	L1	L2	L3
MÁXIMO (W)	27.015,8	26.974,0	27.099,3
MÍNIMO (W)	25.344,2	25.611,6	25.891,9
PROMEDIO (W)	25.750,9	26.147,7	26.433,5
horas	8.760,0	8.760,0	8.760,0
consumo por fase (kWh)	225.577,8	229.053,7	231.557,7
consumo anual estimado (kWh)	686.189,1		
PF	0,870	0,900	0,890

